

DRIVEWAY & SIDEWALK APPLICATION

CITY OF STOUGHTON

This information is not all inclusive of the requirements for sidewalks and driveways.

PROPERTY OWNER _____

ADDRESS _____

PHONE _____

CONTRACTOR _____

SIDEWALK: LENGTH IN FEET _____ WIDTH IN FEET _____

THICKNESS SHALL BE 4 INCHES, 6 INCHES IF THROUGH A DRIVEWAY.
WIDTH SHALL BE 5 FEET AND MAY TAPER TO MATCH EXISTING SIDEWALK.
PLACEMENT SHALL BE WITHIN 6 INCHES OUTSIDE THE PROPERTY LOT LINE
OR EVEN WITH EXISTING. BACKFILLING AROUND SIDEWALKS SHALL OCCUR
AS SOON AS PRACTICAL AFTER 7-DAY CURE.

*SEE SPECIFICATIONS ON BACK.

DRIVEWAY: CIRCLE ONE: BLACKTOP/CONCRETE

WIDTH AT CURB _____ WIDTH AT OUTER EDGE OF SIDEWALK _____

DISTANCE FROM NEAREST DRIVEWAY _____

A SIDEWALK SECTION SHALL BE CONSTRUCTED THROUGH THE DRIVEWAY
ACCORDING TO CITY STANDARDS.

.....
OWNER/AGENT SIGNATURE _____


DATE _____

APPROVAL: YES NO

COMMENTS: _____

CITY OF STOUGHTON SIDEWALK SPECIFICATIONS

TYPICAL SECTION

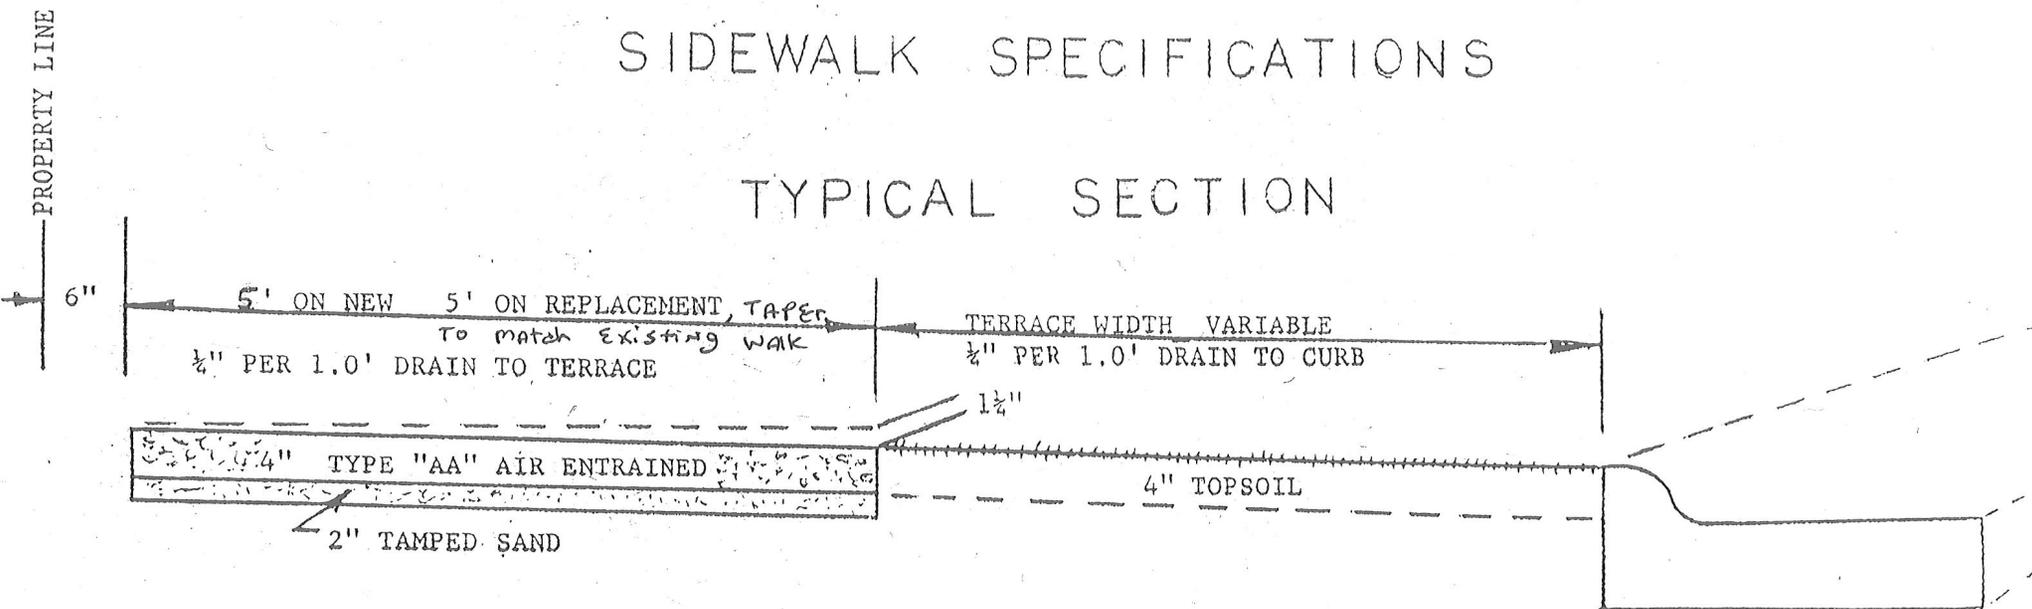

MIX

READY- MIX 5 1/2 BAG

3/4" Stone

Water Maximum- 6 Gals. per Sack of Cement

SLUMP- 4"

THICKNESS AT DRIVEWAY- 6"

Place 4 #4 re-rods below neutral axis at all lateral crossings on new.
Medium broom finish.

Jointed at 5' intervals and expansion jt. at 25' intervals.